


**Notes:**

1. Members are responsible for rack, ground rod, and panel along with the wire.
2. If the panels are within 50' of the transformer, & within sight, they may be mounted on the building.

**ALL work Shall be installed in a neat and workman-like manner per NEC 110.12**

**FEC has the authority of interpretation of "neat and workman-like manner" based on our experiences or precedents as the basis of our judgements.**

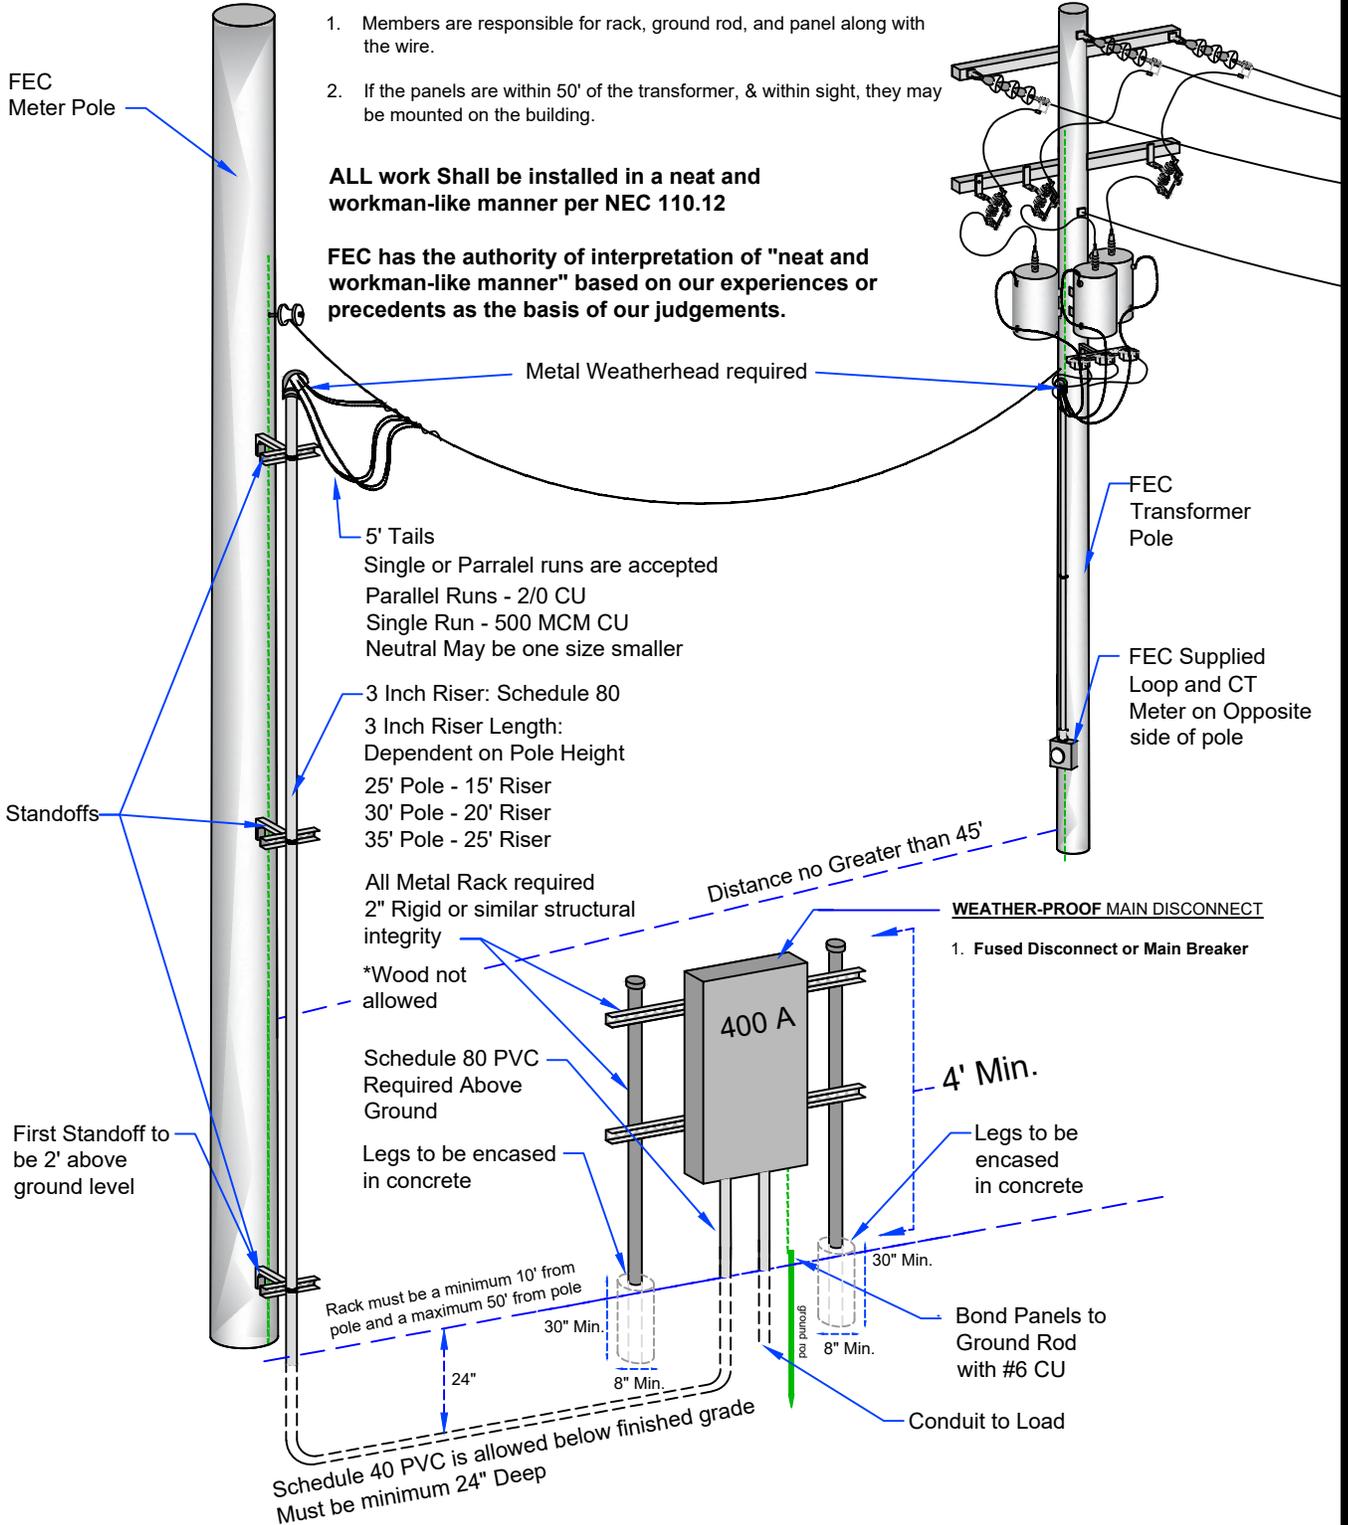

DATE: 3/20/2025



## Three Phase 400 Amp Service Rack - off Meter Pole

**Phone**

**(979) 968-3181 1-866-968-3181**

**MS-52**